



Yaxley Synchronous Condenser

Noise Impact Assessment for Planning Condition Discharge

27th October 2023

inacoustic | **bristol**

Caswell Park, Caswell Lane, Clapton-in-Gordano, Bristol, BS20 7RT

0117 325 3949 | www.inacoustic.co.uk | bristol@inacoustic.co.uk

inacoustic is a trading name of Inacoustic Limited, registered in the UK 10873933

Version	Comments	Date	Authored By	Checked By	Project Number
1	Noise Assessment for Planning Condition Discharge	20/10/2023	Victor Valeron BEng MSc MIOA	Antony Best BSc (Hons) MIOA	23-554
2	Typo corrected	20/10/2023	Victor Valeron BEng MSc MIOA	Antony Best BSc (Hons) MIOA	23-554
3	Client's comments	27/10/2023	Victor Valeron BEng MSc MIOA	Antony Best BSc (Hons) MIOA	23-554

This report has been prepared for the titled project or named part thereof and should not be used in whole or part and relied upon for any other project without the written authorisation of the author. No responsibility or liability is accepted by the author for the consequences of this document if it is used for a purpose other than that for which it was commissioned. Persons wishing to use or rely upon this report for other purposes must seek written authority to do so from the owner of this report and/or the author and agree to indemnify the author for any loss or damage resulting there from. The author accepts no responsibility or liability for this document to any other party than the person by whom it was commissioned.

The findings and opinions expressed are relevant to the dates of the site works and should not be relied upon to represent conditions at substantially later dates. If additional information becomes available which may affect our comments, conclusions or recommendations, the author reserves the right to review the information, reassess any new potential concerns and modify our opinions accordingly.

CONTENTS

1.	INTRODUCTION	5
1.1.	OVERVIEW	5
1.2.	SCOPE AND OBJECTIVES	5
2.	ASSESSMENT CRITERIA	6
2.1.	PLANNING CONDITION	6
2.2.	BS4142:2014+A1:2019	6
2.3.	RELATIVE CHANGE IN AMBIENT NOISE LEVEL	7
3.	SITE DESCRIPTION	8
3.1.	SITE AND SURROUNDING AREA	8
3.2.	REVISED DEVELOPMENT OVERVIEW	9
4.	MEASUREMENT METHODOLOGY	11
4.1.	GENERAL	11
4.2.	MEASUREMENT DETAILS	11
4.3.	SOUND INDICES	13
4.4.	SUMMARY RESULTS	13
5.	OPERATIONAL NOISE ASSESSMENT	14
5.1.	NOISE MODELLING	14
5.2.	ASSESSMENT	18
6.	CONCLUSION	24
7.	APPENDICES	25
7.1.	APPENDIX A – DEFINITION OF TERMS	26
7.2.	APPENDIX B – SOUND MEASUREMENT RESULTS	29
7.3.	APPENDIX C – STATISTICAL ANALYSIS	31

FIGURES

FIGURE 1: REVISED DEVELOPMENT SITE AND SURROUNDING AREA	8
FIGURE 2: PLANNED DEVELOPMENT LAYOUT	9
FIGURE 3: PLANNED DEVELOPMENT ELEVATIONS	10
FIGURE 4: MEASUREMENT POSITIONS	12
FIGURE 5: SPECIFIC SOUND LEVEL MAP - DAYTIME	16
FIGURE 6: SPECIFIC SOUND LEVEL MAP - NIGHT-TIME	17
FIGURE 7: CONSENTED YAXLEY SUBSTATION	23
FIGURE 8: MEASURED TIME HISTORY - MP1	29
FIGURE 9: MEASURED TIME HISTORY - MP2	30
FIGURE 10: STATISTICAL ANALYSIS OF L_{A90} BACKGROUND - DAYTIME - MP1	31
FIGURE 11: STATISTICAL ANALYSIS OF L_{A90} BACKGROUND - NIGHT-TIME - MP1	31
FIGURE 12: STATISTICAL ANALYSIS OF L_{A90} BACKGROUND - DAYTIME - MP2	32
FIGURE 13: STATISTICAL ANALYSIS OF L_{A90} BACKGROUND - NIGHT-TIME - MP12	32

TABLES

TABLE 1: IMPACT SCALE FOR COMPARISON OF FUTURE NOISE AGAINST EXISTING NOISE	7
TABLE 2: INVENTORY OF SOUND MEASUREMENT EQUIPMENT	11
TABLE 3: MEASUREMENT POSITION DESCRIPTION	12
TABLE 4: SOUND MEASUREMENT RESULTS	13
TABLE 5: SOUND SOURCE DATA	14
TABLE 6: PREDICTED SPECIFIC SOUND LEVEL SUMMARY	17
TABLE 7: RATING PENALTY ASSESSMENT	19
TABLE 8: MEASUREMENT UNCERTAINTY FACTORS	20
TABLE 9: CALCULATION UNCERTAINTY FACTORS	21
TABLE 10: BS4142 ASSESSMENT AT NSR1	22
TABLE 11: TYPICAL SOUND LEVELS FOUND IN THE ENVIRONMENT	27

1. INTRODUCTION

1.1. Overview

inacoustic has been commissioned to assess the impact of potential noise arising from a revised Synchronous Condenser facility on Land at The Leys and Ivy Farm, Mellis Road, Yaxley, Eye, IP23 8DB.

This report details the existing background sound climate at the nearest noise-sensitive receptors, as well as the potential sound emissions associated with the Revised Development.

The assessment considers the potential noise generation from the plant associated with the Revised Development, with respect to existing sound levels in the area. The assessment methodology contained in British Standard 4142:2014+A1:2019 *Method for rating and assessing industrial and commercial sound* has been used.

Following gaining permission for the Section 73 application to pursue a single-condenser layout, the following technical noise assessment has been produced to discharge the noise-related Planning Condition set out by Mid Suffolk District Council (Planning Application: DC/23/01494) and is based upon environmental noise measurements undertaken at the site and a subsequent 3-dimensional noise modelling exercise.

This noise assessment is necessarily technical in nature; therefore a glossary of terms is included in Appendix A to assist the reader.

1.2. Scope and Objectives

The scope of the noise assessment can be summarised as follows:

- A sound monitoring survey was undertaken at discrete locations representative of the closest noise-sensitive receptors to the Site;
- A 3-dimensional noise modelling exercise, in order to quantify the potential noise generation of the planned site uses;
- An assessment of potential noise impacts with respect to the prevailing acoustic conditions at existing off-site receptors; and
- Recommendation of mitigation measures, where necessary, to comply with the requirements of Planning Condition 11.

2. ASSESSMENT CRITERIA

2.1. Planning Condition

It is understood that decision notice for the now consented original two synchronous condensers scheme (Planning Application: DC/23/01494) included the following noise-related Planning Condition:

11. ACTION REQUIRED PRIOR TO OPERATION: NOISE ASSESSMENT

Before the development is first operated, a noise assessment shall be undertaken by a competent individual to demonstrate that the rating level of sound emitted from the development shall not exceed background sound levels taken as a one hour LA90 during the day (07:00-23:00) and 15 minute LA90 during the night (23:00-07:00) at the nearest sound sensitive premises. All measurements shall be made in accordance with the methodology of BS4142 (2014) (Methods for rating and assessing industrial and commercial sound) and/or its subsequent amendments. Where access to the nearest sound sensitive property is not possible, measurements shall be undertaken at an appropriate location and corrected to establish the noise levels at the nearest sound sensitive property. In the event that the sound emitted from the development is shown to exceed the background sound levels an attenuation scheme, to ensure the sound level is mitigated to no greater than background levels, shall be submitted to and agreed in writing with the local planning authority. The attenuation scheme as may be agreed shall be carried out in its entirety before the first operation of the development and shall be retained throughout the lifetime of the development.

Reason - In the interest of the amenity of neighbouring residents.

2.2. BS4142:2014+A1:2019

BS4142:2014+A1:2019 sets out a method to assess the likely effect of sound from factories, industrial premises or fixed installations and sources of an industrial nature in commercial premises, on people who might be inside or outside a dwelling or premises used for residential purposes in the vicinity.

The procedure contained in BS4142:2014+A1:2019 for assessing the effect of sound on residential receptors is to compare the measured or predicted sound level from the source in question, the $L_{Aeq,T}$ *specific sound level*, immediately outside the dwelling with the $L_{A90,T}$ background sound level.

Where the sound contains a tonality, impulsivity, intermittency and other sound characteristics, then a correction depending on the grade of the aforementioned characteristics of the sound is added to the specific sound level to obtain the $L_{Ar,Tr}$ *rating sound level*. The effect of uncertainty in sound measurements, data and calculations should also be considered when necessary.

BS4142:2014+A1:2019 states: *"The significance of sound of an industrial and/or commercial nature depends upon both the margin by which the rating level of the specific sound source exceeds the background sound level and the context in which the sound occurs"*. An estimation of the impact of the specific sound can be obtained by the difference of the rating sound level and the background sound level and considering the following:

- *"Typically, the greater this difference, the greater the magnitude of the impact."*
- *"A difference of around +10dB or more is likely to be an indication of a significant adverse impact, depending on the context."*
- *"A difference of around +5dB is likely to be an indication of an adverse impact, depending on the context."*
- *"The lower the rating level is relative to the measured background sound level, the less likely it is that the specific sound source will have an adverse impact or a significant adverse impact. Where the rating level does not exceed the background sound level, this is an indication of the specific sound source having a low impact, depending on the context."*

During the daytime, the assessment is typically carried out over a reference time period of 1-hour, with a reference period of 15-minutes used for the night-time assessment. The periods associated with day or night, for the purposes of the Standard, are considered to be 07.00 to 23.00 and 23.00 to 07.00, respectively.

2.3. Relative Change in Ambient Noise Level

The IEMA Guidelines¹ define 'Noise Impact' as the difference in the acoustic environment before and after the implementation of the proposals, also known as the magnitude of change. In circumstances where a noise environment may be altered by addition or removal of a noise source, considered to be largely anonymous or within the prevailing acoustic character of an area, for example, changes to traffic quantum or patterns, it is normal to consider this relative change in ambient noise level. The assessment, therefore, considers this phenomenon to add context.

The impact scale adopted in this assessment is shown in Table 1 below, which relates to established human responses to noise, in line with 'Table 7-12 Effect Descriptors' of the IEMA Guidelines and set in the context of NPPG.

TABLE 1: IMPACT SCALE FOR COMPARISON OF FUTURE NOISE AGAINST EXISTING NOISE

Noise Level Change dB(A)	Subjective Response	Significance	NPPG Context
Less than 1.0	No perceptible	Negligible	NOEL
1.0 – 2.9	Barely perceptible	Minor impact	NOAEL
3.0 – 4.9	Noticeable	Moderate impact	LOAEL
5.0 – 9.9	Up to a doubling or halving of loudness	Substantial impact	SOAEL
10.0 or more	More than a doubling or halving of loudness	Major impact	UAEL

The criteria above reflect the key benchmarks that relate to human perception of sound. A change of 3 dB(A) is generally considered to be the smallest change in environmental noise that is perceptible to the human ear. A 10 dB(A) change in noise represents a doubling or halving of the perception of loudness. The difference between the minimum perceptible change and the doubling or halving of the noise level is split to provide greater definition to the assessment of changes in noise level.

It is considered that the criteria specified in Table 1 provide a good indication as to the likely significance of changes in noise levels in this case and can be used to inform the context in which the sound occurs in order to assess the impact of noise from the Revised Development.

¹ Institute of Environmental Management & Assessment (IEMA), Version 1.2 (November 2014). Guidelines for Environmental Noise Impact Assessment

3. SITE DESCRIPTION

3.1. Site and Surrounding Area

The Revised Development is on a parcel of land to the west of the A140 route corridor and to the north of Mellis Road.

The site is surrounded by agricultural land. The closest noise sensitive receptor (NSRs) to the site comprises a group of dwellings at NSR1, one of which is within the same land ownership as the site, approximately 215m to the north west of the site boundary, with the other third-party dwelling in this group, Meadow Barn, located 235 m north of the site, and residential dwellings along Mellis Road, approximately 500m to the south of the site boundary.


The ambient sound environment in the area was influenced by local road traffic noise and natural sources.

The Revised Development site and the surrounding area can be seen in Figure 1.

FIGURE 1: REVISED DEVELOPMENT SITE AND SURROUNDING AREA



FIGURE 3: PLANNED DEVELOPMENT ELEVATIONS

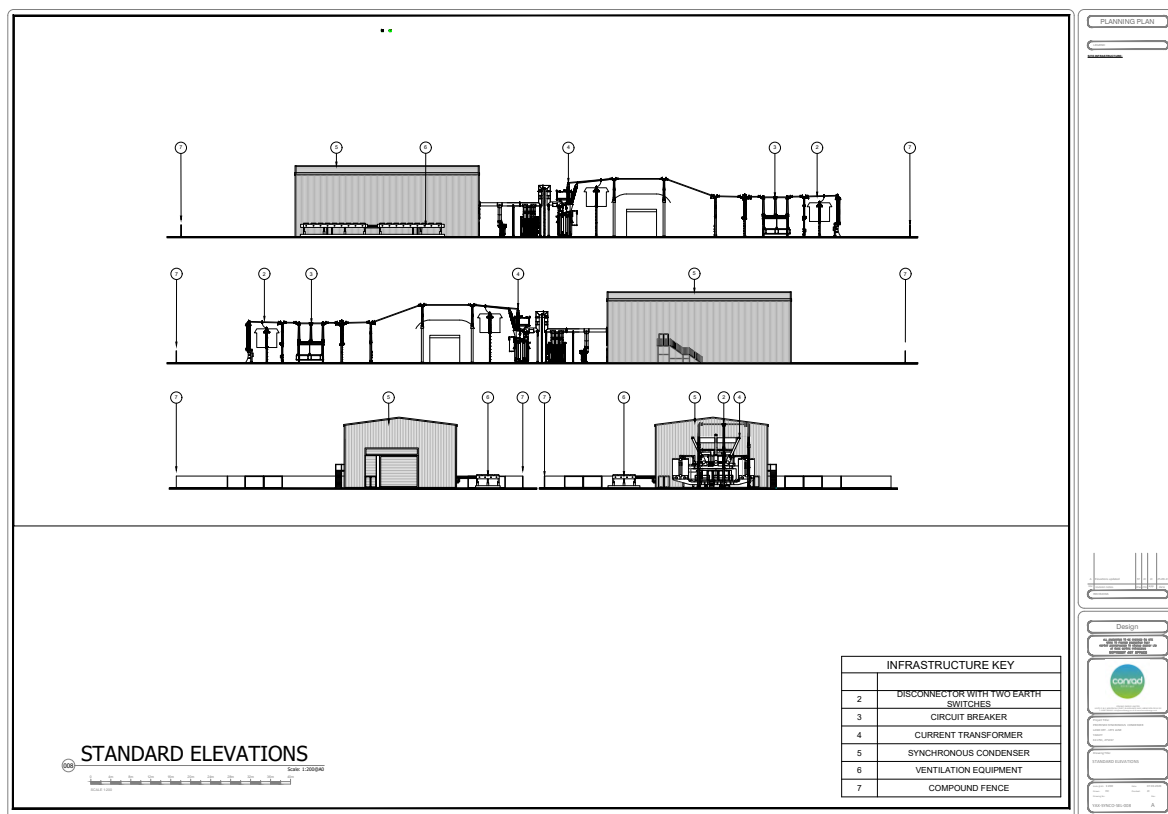

4. MEASUREMENT METHODOLOGY

4.1. General

The prevailing noise conditions in the area have been determined by an environmental noise survey conducted during both daytime and night-time periods between Tuesday 17th and Wednesday 25th May 2022.

4.2. Measurement Details

All noise measurements were undertaken by a consultant certified as competent in environmental noise monitoring, and, in accordance with the principles of BS 7445².

All acoustic measurement equipment used during the noise survey conformed to Type 1 specification of British Standard 61672³. A full inventory of this equipment is shown in Table 2 below.

TABLE 2: INVENTORY OF SOUND MEASUREMENT EQUIPMENT

Measurement Position	Make, Model & Description	Serial Number	Certificate Number	Calibration Expiry Date
MP1	Rion NL-52 Sound Level Meter	764926	199989	11/06/2022
	Rion NH-25 Preamplifier	76427		
	Rion UC-59 Microphone	12922		
MP2	Brue & Kjaer 2238	2328256	1123444	11/02/2024
	B&K Preamplifier ZC 0030	-		
	B&K 4188	2793288		
Both	Cirrus CR:515 Calibrator	80029	TCRT22/1229	7/04/2023

The sound measurement equipment used during the survey was field calibrated at the start and end of the measurement period. A calibration laboratory has calibrated the field calibrator used within the twelve months preceding the measurements. A drift of less than 0.2 dB in the field calibration was found to have occurred on the sound level meter.

The weather conditions during the survey were conducive to environmental noise measurement; it being largely dry, with wind speeds typically below 5 ms⁻¹, as recorded on site with a weather station. When periods of inclement weather were noted to occur, they have been removed from the dataset used to derive the typical background sound level.

The microphone was fitted with a protective windshield for the measurements, which is described in Table 3, with an aerial photograph indicating its location shown in Figure 4.

² British Standard 7445: 2003: Description and measurement of environmental noise. BSI

³ British Standard 61672: 2013: Electroacoustics. Sound level meters. Part 1 Specifications. BSI.

TABLE 3: MEASUREMENT POSITION DESCRIPTION

Measurement Position	Description
MP1	A largely unattended daytime and night-time measurement of sound at the Farm House to the north west of the Site, under free-field conditions, at a height of 1.5 metres above local ground level. The sound environment at this location during our time on site was influenced by electrical buzzing noise from overhead power lines, wind turbines in the distance and natural sounds such as birdsong and wind-induced vegetation movement. Very infrequent car passbys on the lane to the farm were also noted. Construction vehicles to the south, associated with another site were also noted, although they were not active during the attended period.
MP2	A largely unattended daytime and night-time measurement of sound at the closest NSRs to the south of the Site, off Mellis Road, under free-field conditions, at a height of 1.5 metres above local ground level. The sound environment at this location during our time on site was influenced by road traffic noise contributions from vehicles travelling on Mellis Road and natural sounds such as birdsong and wind-induced vegetation movement. Agricultural vehicles on the surrounding land were also noted occasionally.

FIGURE 4: MEASUREMENT POSITIONS



4.3. Sound Indices

The parameters reported are the average Equivalent Continuous Sound Level, $L_{Aeq,T}$, the statistical index (typical) Background Sound Level, $L_{A90,T}$, as well as the and the typical Maximum Sound Pressure Level, L_{AFmax} . An explanation of the sound units presented is given in Appendix A.

The measured L_{Aeq} , L_{AFmax} , and L_{AF90} sound levels are presented as time histories in a graph in Appendix B. Furthermore, the statistical distribution of the measured background sound levels to derive the typical representative $L_{A90,T}$ values are presented in a graphical format in Appendix C.

4.4. Summary Results

The summarised results of the environmental sound measurements, during the day and night-time periods, can be seen below in Table 4. Values have been rounded to the nearest whole number.

TABLE 4: SOUND MEASUREMENT RESULTS

Measurement Position	Period	$L_{Aeq,T}$ (dB)	$L_{AF90,T}$ (dB)	L_{AFmax} (dB)
MP1	Day	49	37	73
	Night	44	36	66
MP2	Day	47	34	73
	Night	45	32	66

5. OPERATIONAL NOISE ASSESSMENT

5.1. Noise Modelling

5.1.1. Source Data

The A-weighted sound power levels of external plant associated with the Revised Development can be seen below in Table 5. At this stage, these are considered robust candidate source noise levels representative of typical technology available for this kind of plant, to be achieved by the scheme design.

TABLE 5: SOUND SOURCE DATA

Plant	Quantity	Sound Power Level per unit, L_{WA} (dB)
Main Transformer	1	92
Auxiliary Transformer	1	46
Start Up Transformer	2	46
DNO Substation	1	78
Outdoor Cooling	4	82 (day - nominal speed) 76 (night - reduced speed)

The maximum 1/3 octave sound power level for the main transformer at 100Hz is assumed to not exceed 99 dB (lineal).

In addition, it is assumed that the Synchronous Generators and Flywheels will be housed within an acoustic enclosure to limit noise emissions to 85 dB(A) at 1m, including the ventilation system. The acoustic enclosure itself will be located within the Main Generation Building. The reverberant Sound Pressure Level within the Main Generation Building is calculated to be 90 dB(A), and should be achieved by design.

The Main Generation Building is assumed to comprise standard thermal insulated panels in the walls and roof, with a minimum sound reduction performance of 24 dB R_w , which is typical on this kind of systems.

Ventilation louvres on the Main Generation Building should be designed such that they do not downgrade the acoustic performance of the building, either by orientation away from the direction of noise-sensitive receptors or by the use of acoustically attenuated louvres where required.

5.1.2. Calculation Process

Calculations were carried out using Cadna/A, which undertakes its calculations in accordance with guidance given in ISO9613-1:1993 and ISO9613-2:1996.

5.1.3. Model Assumptions

Given that the land between the Revised Development and nearest receptors is largely soft, the ground factor has been set to 0.8 within the calculation software, with 2 orders of reflection. Full octave frequency spectrum has been used in the calculations. For the Main Transformers, 1/3 octave frequency bands have been considered. It has been assumed that all processes will occur simultaneously, representing a worst-case scenario.

In order to accurately model the land surrounding the development, an AutoCAD DXF drawing was produced based on Ordnance Survey, along with associated topographic contours sourced from Defra.

5.1.4. Mitigation by Design

As mentioned before, embedded mitigations include the Synchronous Generators and Flywheels being housed within an acoustic enclosure to limit noise emissions to 85 dB(A) at 1m, including the ventilation system, with the acoustic enclosure itself located within the Main Generation Building.

In order to reduce the potential noise impact of the Revised Development, an iterative assessment of other suitable noise mitigation techniques has been undertaken.

Section 5.1.1 presents the maximum sound emission levels required to achieve compliance at the most potentially noise-affected receptors. To achieve this, acoustic mitigation might need to be employed on the Main Transformers, in order to achieve the emission levels presented in Section 5.1.1, depending on the final manufacturer and plant selection.

5.1.5. Specific Sound Level Map

The sound map showing the specific sound level emissions from the Revised Development can be seen in Figure 5 and Figure 6 for daytime and night-time periods respectively.

FIGURE 5: SPECIFIC SOUND LEVEL MAP - DAYTIME


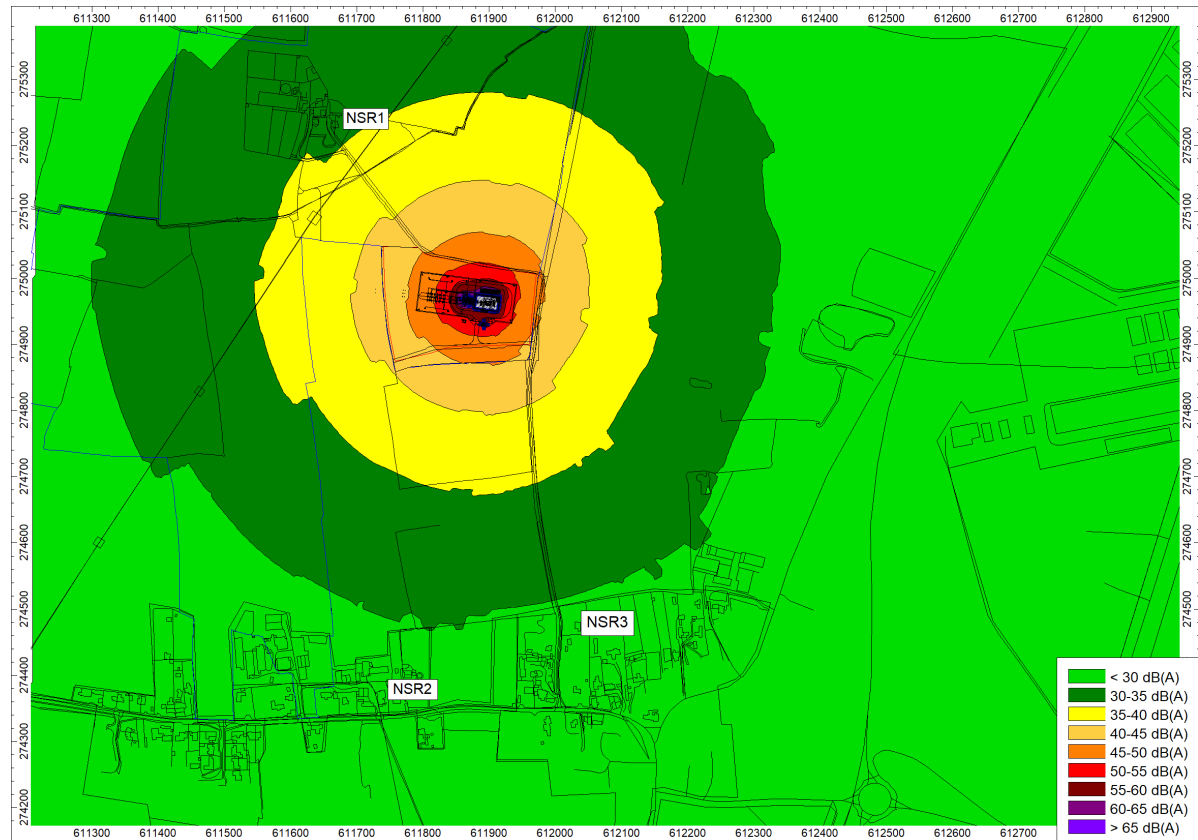


FIGURE 6: SPECIFIC SOUND LEVEL MAP – NIGHT-TIME

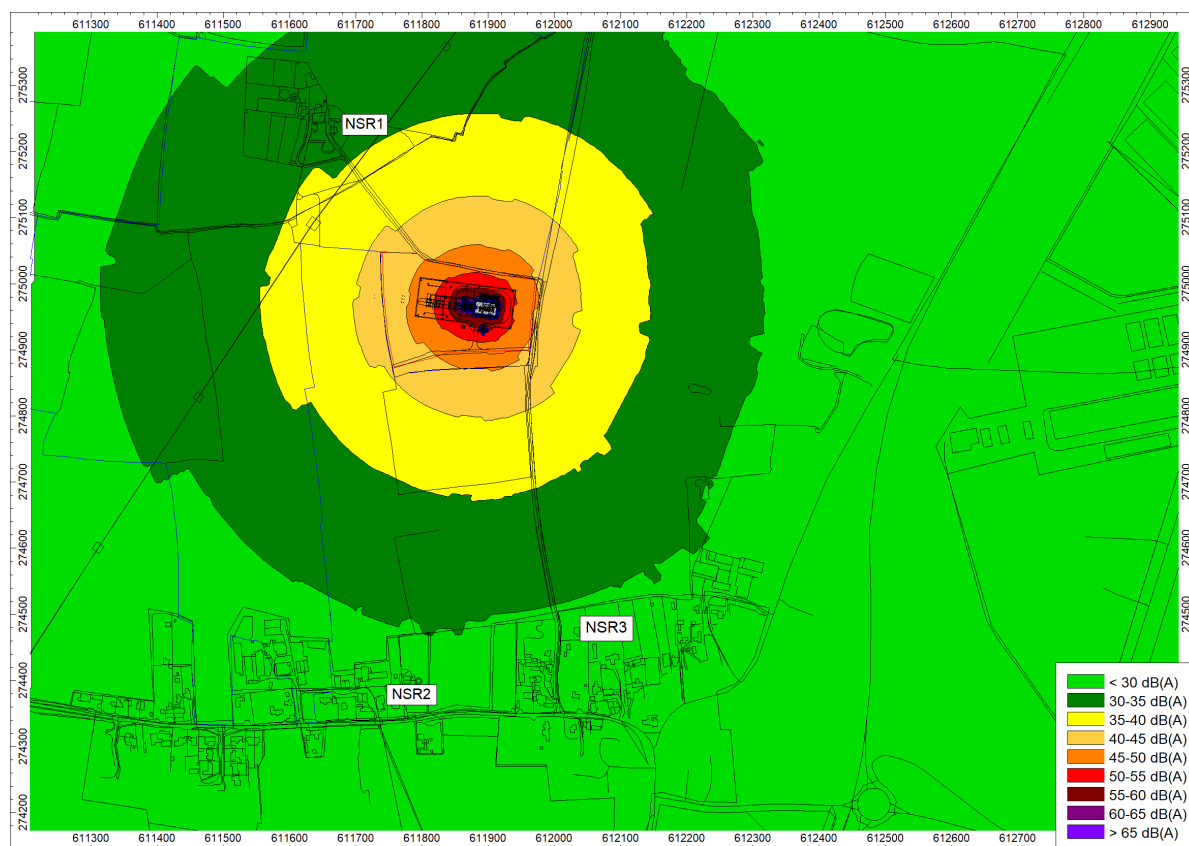

5.1.6. Specific Sound Level Summary

A summary of the predicted specific sound levels at the closest NSRs, based on the sound maps shown in Figure 5 and Figure 6 can be seen below in Table 6.

TABLE 6: PREDICTED SPECIFIC SOUND LEVEL SUMMARY

NSR	Period	Specific Sound Level (dB)
NSR1	Daytime (07:00-23:00)	34
	Night-time (23:00-07:00)	34
NSR2	Daytime (07:00-23:00)	28
	Night-time (23:00-07:00)	28
NSR3	Daytime (07:00-23:00)	30
	Night-time (23:00-07:00)	29

5.2. Assessment

5.2.1. Rating Penalty Principle

Section 9 of BS4142:2014+A1:2019 describes how the rating sound level should be derived from the specific sound level, by determining a rating penalty. BS4142:2014+A1:2019 states:

“Certain acoustic features can increase the significance of impact over that expected from a basic comparison between the specific sound level and the background sound level. Where such features are present at the assessment location, add a character correction to the specific sound level to obtain the rating level. This can be approached in three ways:

- a) subjective method;*
- b) objective method for tonality;*
- c) reference method.”*

Given that the Revised Development is not operational, the subjective method has been adopted to derive the rating sound level from the specific sound level. This is discussed in Section 9.2 of BS4142:2014+A1:2019, which states:

“Where appropriate, establish a rating penalty for sound based on a subjective assessment of its characteristics. This would also be appropriate where a new source cannot be measured because it is only proposed at that time, but the characteristics of similar sources can subjectively be assessed.

Correct the specific sound level if a tone, impulse or other characteristics occurs, or is expected to be present, for new or modified sound sources.”

BS4142:2014+A1:2019 defines four characteristics that should be considered when deriving a rating penalty, namely; tonality; impulsivity; intermittency; and other sound characteristics, which are defined as:

Tonality

A rating penalty of +2 dB is applicable for a tone which is *“just perceptible”*, +4 dB where a tone is *“clearly perceptible”*, and +6 dB where a tone is *“highly perceptible”*.

Impulsivity

A rating penalty of +3 dB is applicable for impulsivity which is *“just perceptible”*, +6 dB where it is *“clearly perceptible”*, and +9 dB where it is *“highly perceptible”*.

Intermittency

BS4142:2014+A1:2019 states that when the *“specific sound has identifiable on/off conditions, the specific sound level ought to be representative of the time period of length equal to the reference time interval which contains the greatest total amount of on time ... if the intermittency is readily distinctive against the residual acoustic environment, a penalty of +3 dB can be applied.”*

Other Sound Characteristics

BS4142:2014+A1:2019 states that where *“the specific sound features characteristics that are neither tonal nor impulsive, though otherwise are readily distance against the residual acoustic environment, a penalty of +3 dB can be applied.”*

5.2.2. Rating Penalty Assessment

Considering the content of Section 5.2.1, an assessment of the various sound sources associated with the Revised Development, in terms of whether any rating penalties are applicable, has been detailed in Table 7 below.

TABLE 7: RATING PENALTY ASSESSMENT

Source	Tonality	Impulsivity	Intermittency	Other Sound Characteristics	Discussion
Synchronous Condenser Site	+2 dB	0 dB	0 dB	0 dB	Synchronous Condenser sites can be despatched as and when required by the system operator, however, once operating, do not cycle on and off. The plant does not produce impulsive noises. Therefore, intermittency or impulsivity penalties are not applicable. Based on the character of the main transformer, this kind of plant will typically produce a tone at the 1/3 octave band of 100Hz at source. The specific sound level at 100 Hz from the main transformer is predicted to be <35dB at SNR1 and <30dB at NSR2 and NSR3. This will ensure that the level is sufficiently low so that the tonality is unlikely to be noticeable, due to the lower sensitivity of the human ear at low frequencies and masking from the residual acoustic environment. However, to consider a worst-case scenario, a penalty of +2 dB has been applied for a tone just perceptible at the noise-sensitive receptor.

In summary, a rating penalty of +2 dB has been included in the assessment as a worst-case scenario.

5.2.3. Uncertainty

BS4142:2014+A1:2019 requires that the level of uncertainty in the measured data and associated calculations is considered in the assessment. The Standard recommends that steps should be taken to reduce the level of uncertainty.

Measurement Uncertainty

BS4142:2014+A1:2019 states that measurement uncertainty depends on a number of factors, including the following, which are applicable to the Revised Development:

- “ ...
- b) the complexity and level of variability of the residual acoustic environment;*
 - “ ...
 - d) the location(s) selected for taking the measurements;*
 - “ ...
 - g) the measurement time intervals;*
 - h) the range of times when the measurements have been taken;*
 - i) the range of suitable weather conditions during which measurements have been taken;*
 - “ ...
 - k) the level of rounding of each measurement recorded; and*
 - l) the instrumentation used.”*

Each of the measurement uncertainty factors outlined above have been considered and discussed in Table 8 below.

TABLE 8: MEASUREMENT UNCERTAINTY FACTORS

Measurement Uncertainty Factor Reference	Level of Uncertainty	Discussion
b)	0 dB	Residual acoustic environment is relatively constant, hence no correction for a complex residual acoustic environment.
d)	0 dB	Measuring at the closest affected receptors to the site has enabled the determination of robust background sound levels.
g)	0 dB	Measurement time intervals were set in accordance with BS4142:2014+A1:2019, hence no further correction needs to be made.
h)	0 dB	Measurements were undertaken over a continuous 8-day interval, including midweek and weekend periods.
i)	0 dB	A weather station was deployed on site. Periods of significant wind or precipitation were excluded from the dataset used to derived the representative background sound levels.
k)	0 dB	Measured values were rounded to 0.1 dB, therefore rounding would not have had a significant impact on the overall typical background sound levels.
l)	0 dB	The acoustic measurement equipment accorded with Type 1 specification of British Standard 61672, and were deployed with appropriate wind shields.

In summary, no uncertainty budget has been considered in the assessment, to account for measurement uncertainty.

Calculation Uncertainty

BS4142:2014+A1:2019 states that calculation uncertainty depends on a number of factors, including the following, which are applicable to the Revised Development:

- “ ...
- b) uncertainty in the operation or sound emission characteristics of the specific sound source and any assumed sound power levels;*
 - c) uncertainty in the calculation method;*
 - d) simplifying the real situation to “fit” the model (user influence on modelling); and*
 - e) error in the calculation process.”*

Each of the calculation uncertainty factors outlined above have been considered and discussed in Table 9 below.

TABLE 9: CALCULATION UNCERTAINTY FACTORS

Calculation Uncertainty Factor Reference	Level of Uncertainty	Discussion
b)	0 dB	Sound source levels are based on robust candidate plant data, to be achieved by the design.
c)	0 dB	Calculations were undertaken in accordance with ISO 9613-2, which is considered a “ <i>validated method</i> ” by BS4142:2014+A1:2019.
d)	0 dB	The real situation has not been simplified for the purposes of this assessment.
e)	±2 dB	ISO 9613-2 indicates that there is a ±2 dB accuracy to the prediction method, therefore, an uncertainty factor of ±2 dB is considered appropriate and proportional, given the separation distances involved.

In summary, an uncertainty budget of ±2 dB has been considered in the assessment, to account for calculation uncertainty.

The overall uncertainty is considered to be small enough that it would not affect the conclusions of the assessment. It is also noted that because the assessment considers a worst-case scenario, such as downwind sound propagation (which in reality cannot happen at all NSRs at the same time) the relevance of the uncertainty is further reduced.

5.2.4. BS4142:2014+A1:2019 Assessment

The rating sound level, as calculated from the predicted specific sound level, has been assessed in accordance with BS4142:2014+A1:2019, at the closest NSRs, and can be seen in Table 10.

TABLE 10: BS4142 ASSESSMENT AT NSR1

NSR	Period	Rating Sound Level (dB)	Background Sound Level (dB)	Excess of Rating over Daytime Background Sound Level (dB)	Impact (Depending on Context)
1	Daytime	36	37	-1	Low Impact
	Night-time	36	36	0	Low Impact
2	Daytime	30	34	-4	Low Impact
	Night-time	30	32	-2	Low Impact
3	Daytime	32	34	-2	Low Impact
	Night-time	31	32	-1	Low Impact

It can be seen that the Revised Development is predicted to have a 'Low Impact' at the nearest noise-sensitive receptors, depending on the context, which is discussed below.

5.2.5. Discussion on Context

The results set out in Table 10 identify that the operation of the scheme, as planned, can occur without affecting the amenity of the closest residential receptors to the site.

BS4142:2014+A1:2019, however, recognises the importance of the context in which a sound occurs when assessing impacts.

It should be noted that the assessment includes a +2dB penalty for tonality as a worst-case scenario, when in reality tonality is unlikely to be readily noticeable. The specific sound level in the 100Hz 1/3 octave band is predicted to be <35 dB (lineal) at NSR1. The average $L_{Aeq,T}$ measured in the same frequency band at MP1 during the day was measured to be 47 dB (lineal). The specific sound level at 100Hz is well below the prevailing sound level, which provides confidence that perceptible tonality is unlikely.


The effect of the Revised Development on the relative change in ambient noise levels at the nearest residential receptors should also be considered as part of the context.

The differential between the predicted daytime specific sound levels (as shown in Table 6), when compared to the measured ambient $L_{Aeq,T}$ sound levels (as shown in Table 4) would ensure that any increase in the prevailing ambient sound level would be negligible; thus ensuring that the development would be categorised as no greater than *No Observed Adverse Effect Level* (NOAEL), in this regard in the context of NPPG England criteria

5.2.6. Cumulative Noise Assessment

For completeness, potential cumulative noise effects from the Revised Development along with the recently approved National Grid Yaxley Substation Connection within the same land ownership (Planning Reference DC/19/02267), has been assessed. The location of the substation, in relation to the planned Synchronous Condenser site can be seen in Figure 7.

FIGURE 7: CONSENTED YAXLEY SUBSTATION

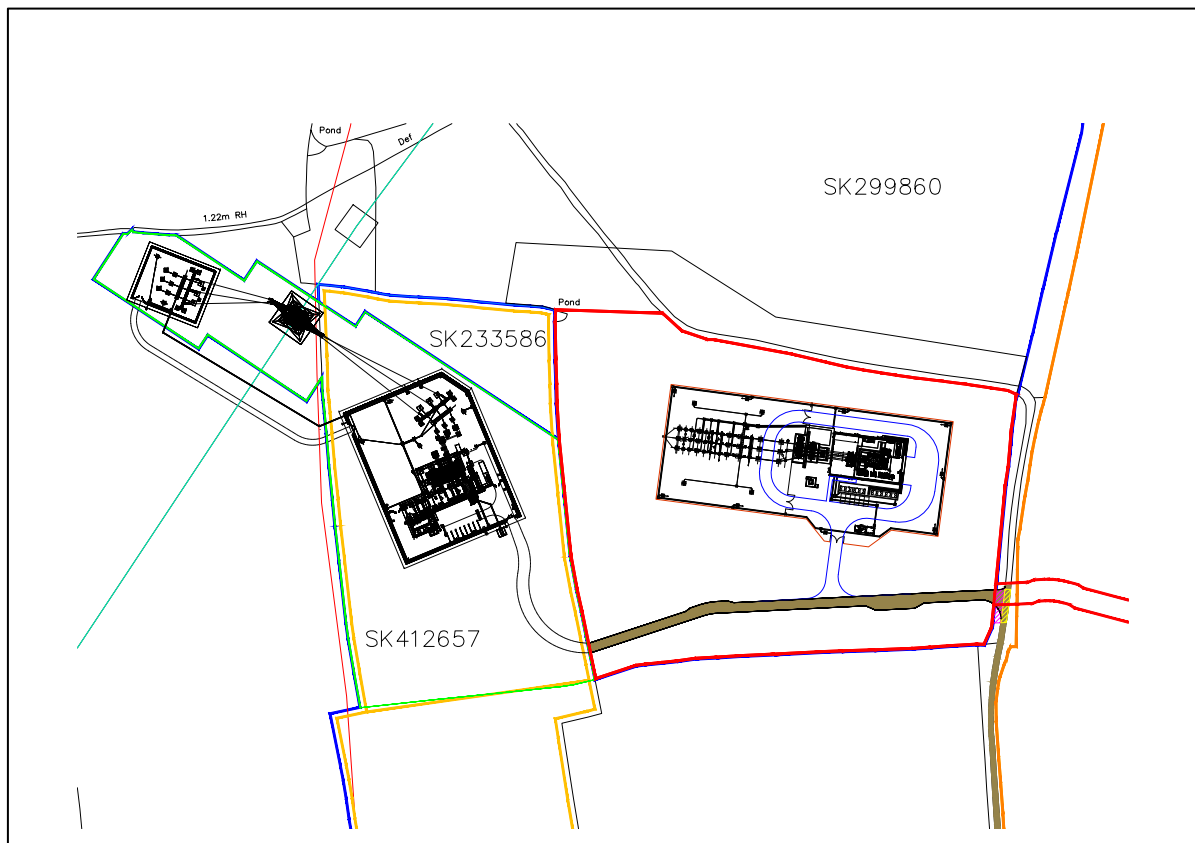

An acoustic assessment for the Yaxley substation is not available in the Planning Portal. Therefore, a qualitative cumulative assessment has been undertaken.

Typically, substation's transformers have a Sound Power Level in the order of 80 dB(A). That is more than 10 dB lower than the sound emissions from the Main Transformer of the Synchronous Condenser site (as presented in Table 5), which ensure that no increase in the sound levels predicted for the Revised Development would be endangered a result of the cumulative operation of both schemes, at the most potentially affected receptors. On that basis, the cumulative assessment of both schemes is expected to be no greater than *No Observed Adverse Effect Level* in the context of NPPG.

6. CONCLUSION

inacoustic has been commissioned to assess the impact of potential noise arising from a revised Synchronous Condenser facility on Land at The Leys and Ivy Farm, Mellis Road, Yaxley, Eye, IP23 8DB.

This technical noise assessment has been produced to discharge the noise-related Planning Condition set out by Mid Suffolk District Council (Planning Application: DC/23/01494) and is based upon environmental noise measurements undertaken at the site and a subsequent 3-dimensional noise modelling exercise.

The assessment considers the potential noise generation from the plant associated with the Revised Development, with respect to existing sound levels in the area, including maximum sound emission levels presented in Table 5.

The assessment methodology contained in British Standard 4142: 2014+A1:2019 *Method for rating and assessing industrial and commercial sound* has been used in conjunction with supplementary acoustic guidance.

The assessment identifies that the Revised Development will give rise to rating sound levels that do not exceed the measured background sound level in the area, thus giving rise to a 'Low Impact'. The assessment goes on to consider the context in which the sound occurs.

The assessment also identifies that no significant tonality or change in ambient sound level at the identified receptor locations will be engendered as a result of the Revised Development in its planned and assessed form and that the amenity of residential receptors will not be compromised.

Consequently, the assessment demonstrates that, providing that the plant is constructed and operated in accordance with the acoustic assumptions and recommendations of this report, Planning Condition 11 can be discharged.

7. APPENDICES

7.1. Appendix A – Definition of Terms

Sound Pressure	Sound, or sound pressure, is a fluctuation in air pressure over the static ambient pressure.
Sound Pressure Level (Sound Level)	The sound level is the sound pressure relative to a standard reference pressure of 20μPa (20x10 ⁻⁶ Pascals) on a decibel scale.
Decibel (dB)	A scale for comparing the ratios of two quantities, including sound pressure and sound power. The difference in level between two sounds s1 and s2 is given by 20 log ₁₀ (s1 / s2). The decibel can also be used to measure absolute quantities by specifying a reference value that fixes one point on the scale. For sound pressure, the reference value is 20μPa.
A-weighting, dB(A)	The unit of sound level, weighted according to the A-scale, which takes into account the increased sensitivity of the human ear at some frequencies.
Noise Level Indices	Noise levels usually fluctuate over time, so it is often necessary to consider an average or statistical noise level. This can be done in several ways, so a number of different noise indices have been defined, according to how the averaging or statistics are carried out.
$L_{eq,T}$	A noise level index called the equivalent continuous noise level over the time period T. This is the level of a notional steady sound that would contain the same amount of sound energy as the actual, possibly fluctuating, sound that was recorded.
$L_{max,T}$	A noise level index defined as the maximum noise level during the period T. L_{max} is sometimes used for the assessment of occasional loud noises, which may have little effect on the overall L_{eq} noise level but will still affect the noise environment. Unless described otherwise, it is measured using the 'fast' sound level meter response.
$L_{90,T}$	A noise level index. The noise level exceeded for 90% of the time over the period T. L_{90} can be considered to be the "average minimum" noise level and is often used to describe the background noise.
$L_{10,T}$	A noise level index. The noise level exceeded for 10% of the time over the period T. L_{10} can be considered to be the "average maximum" noise level. Generally used to describe road traffic noise.
Free-Field	Far from the presence of sound reflecting objects (except the ground), usually taken to mean at least 3.5m
Facade	At a distance of 1m in front of a large sound reflecting object such as a building façade.
Fast Time Weighting	An averaging time used in sound level meters. Defined in BS 5969.

In order to assist the understanding of acoustic terminology and the relative change in noise, the following background information is provided.

The human ear can detect a very wide range of pressure fluctuations, which are perceived as sound. In order to express these fluctuations in a manageable way, a logarithmic scale called the decibel, or dB scale is used. The decibel scale typically ranges from 0 dB (the threshold of hearing) to over 120 dB. An indication of the range of sound levels commonly found in the environment is given in the following table.

TABLE 11: TYPICAL SOUND LEVELS FOUND IN THE ENVIRONMENT

Sound Level	Location
0dB(A)	Threshold of hearing
20 to 30dB(A)	Quiet bedroom at night
30 to 40dB(A)	Living room during the day
40 to 50dB(A)	Typical office
50 to 60dB(A)	Inside a car
60 to 70dB(A)	Typical high street
70 to 90dB(A)	Inside factory
100 to 110dB(A)	Burglar alarm at 1m away
110 to 130dB(A)	Jet aircraft on take off
140dB(A)	Threshold of Pain

The ear is less sensitive to some frequencies than to others. The A-weighting scale is used to approximate the frequency response of the ear. Levels weighted using this scale are commonly identified by the notation dB(A).

In accordance with logarithmic addition, combining two sources with equal noise levels would result in an increase of 3 dB(A) in the noise level from a single source.

A change of 3 dB(A) is generally regarded as the smallest change in broadband continuous noise which the human ear can detect (although in certain controlled circumstances a change of 1 dB(A) is just perceptible). Therefore, a 2 dB(A) increase would not be normally be perceptible. A 10 dB(A) increase in noise represents a subjective doubling of loudness.

A noise impact on a community is deemed to occur when a new noise is introduced that is out of character with the area, or when a significant increase above the pre-existing ambient noise level occurs.

For levels of noise that vary with time, it is necessary to employ a statistical index that allows for this variation. These statistical indices are expressed as the sound level that is exceeded for a percentage of the time period of interest. In the UK, traffic noise is measured as the L_{A10} , the noise level exceeded for 10% of the measurement period. The L_{A90} is the level exceeded for 90% of the time and has been adopted to represent the background noise level in the absence of discrete events. An alternative way of assessing the time varying noise levels is to use the equivalent continuous sound level, L_{Aeq} .

This is a notional steady level that would, over a given period of time, deliver the same sound energy as the actual fluctuating sound.

To put these quantities into context, where a receiver is predominantly affected by continuous flows of road traffic, a doubling or halving of the flows would result in a just perceptible change of 3 dB, while an increase of more than 25%, or a decrease of more than 20%, in traffic flows represent changes of 1 dB in traffic noise levels (assuming no alteration in the mix of traffic or flow speeds).

Note that the time constant and the period of the noise measurement should be specified. For example, BS 4142 specifies background noise measurement periods of 1 hour during the day and 15 minutes during the night. The noise levels are commonly symbolised as $L_{A90,1\text{hour}}$ dB and $L_{A90,15\text{mins}}$ dB. The noise measurement should be recorded using a 'FAST' time response equivalent to 0.125 ms.

7.2. Appendix B – Sound Measurement Results

FIGURE 8: MEASURED TIME HISTORY – MP1


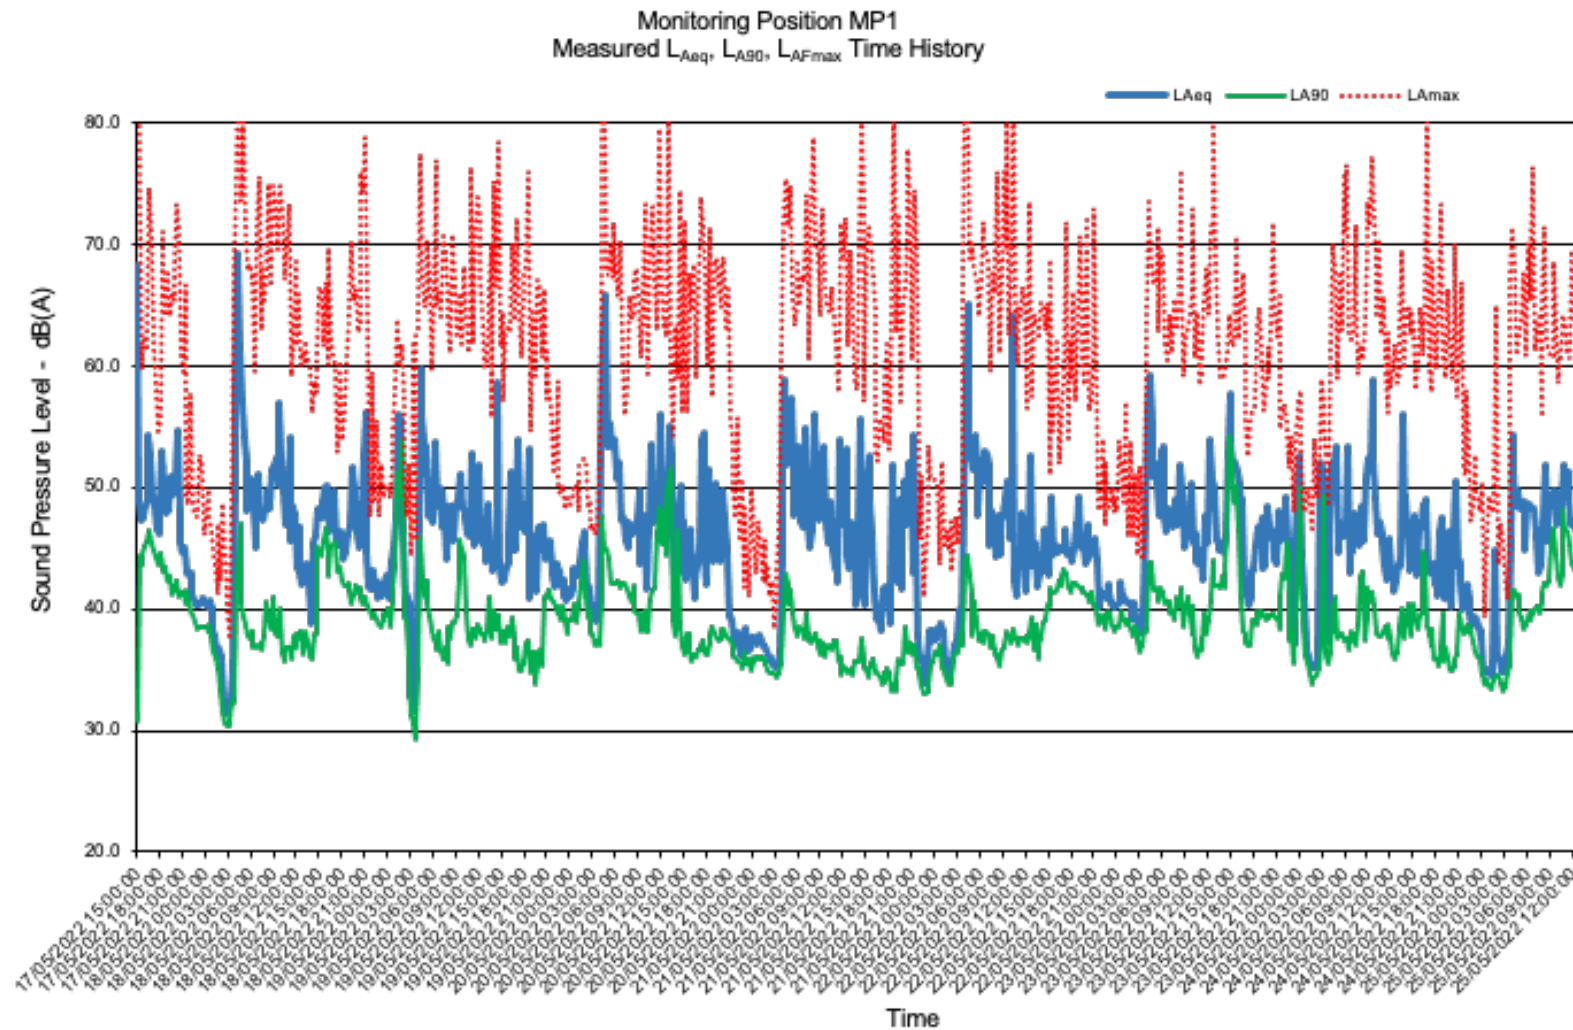


FIGURE 9: MEASURED TIME HISTORY – MP2

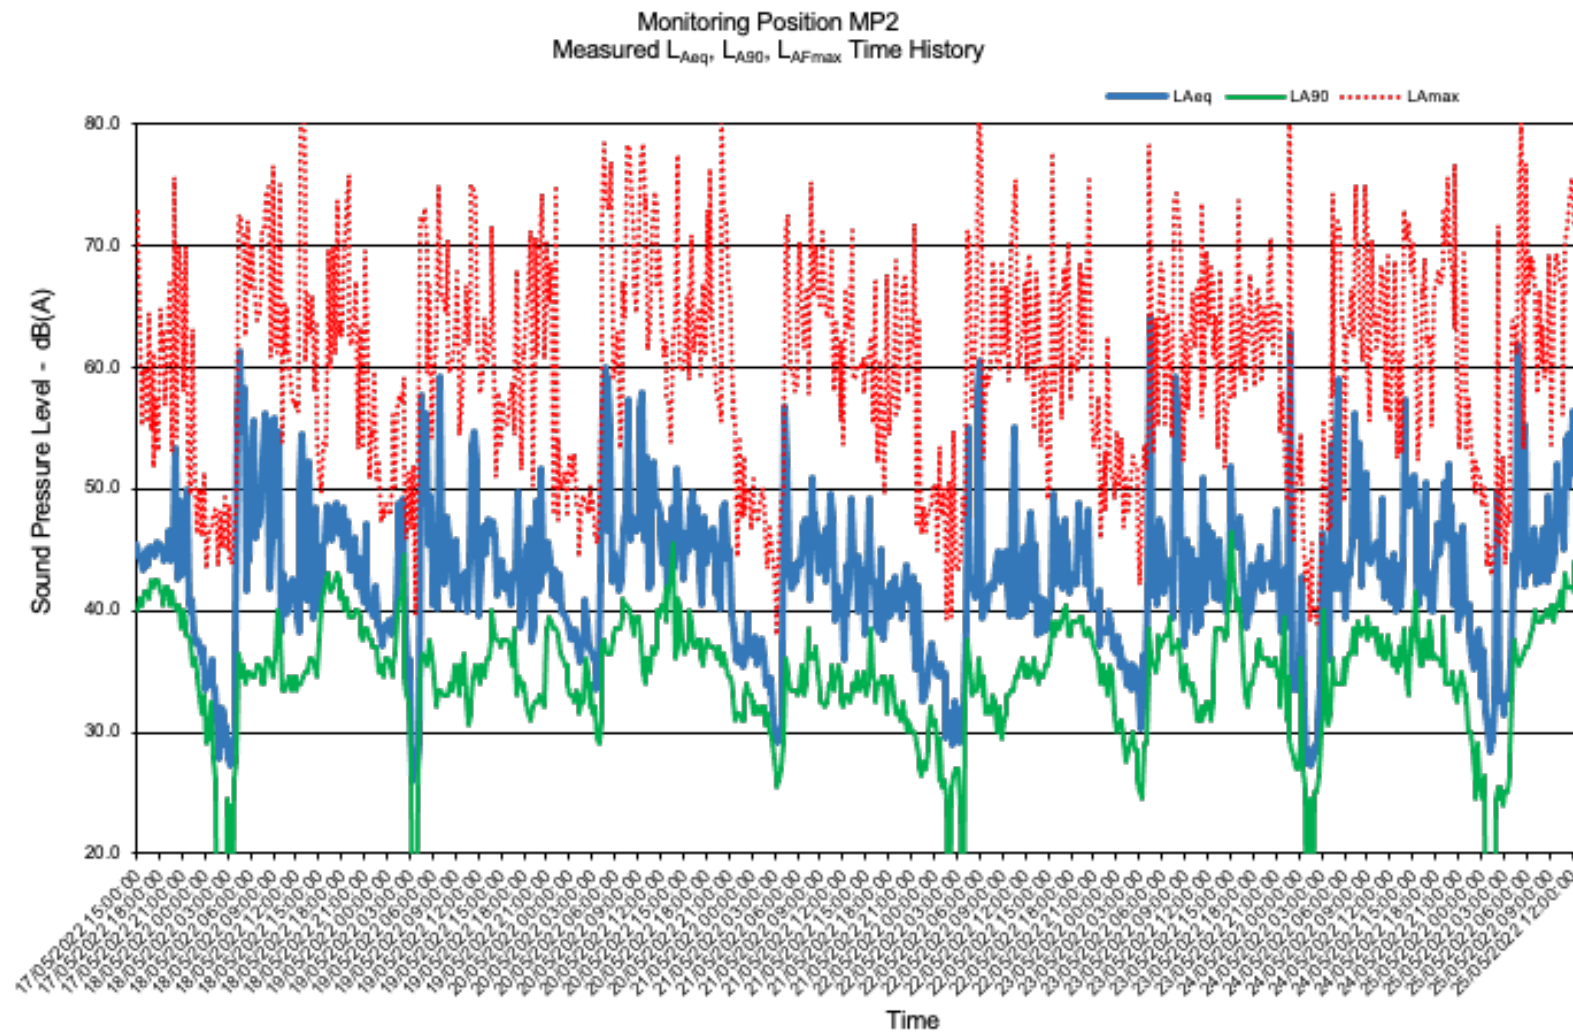

7.3. Appendix C – Statistical Analysis

FIGURE 10: STATISTICAL ANALYSIS OF L_{A90} BACKGROUND – DAYTIME – MP1

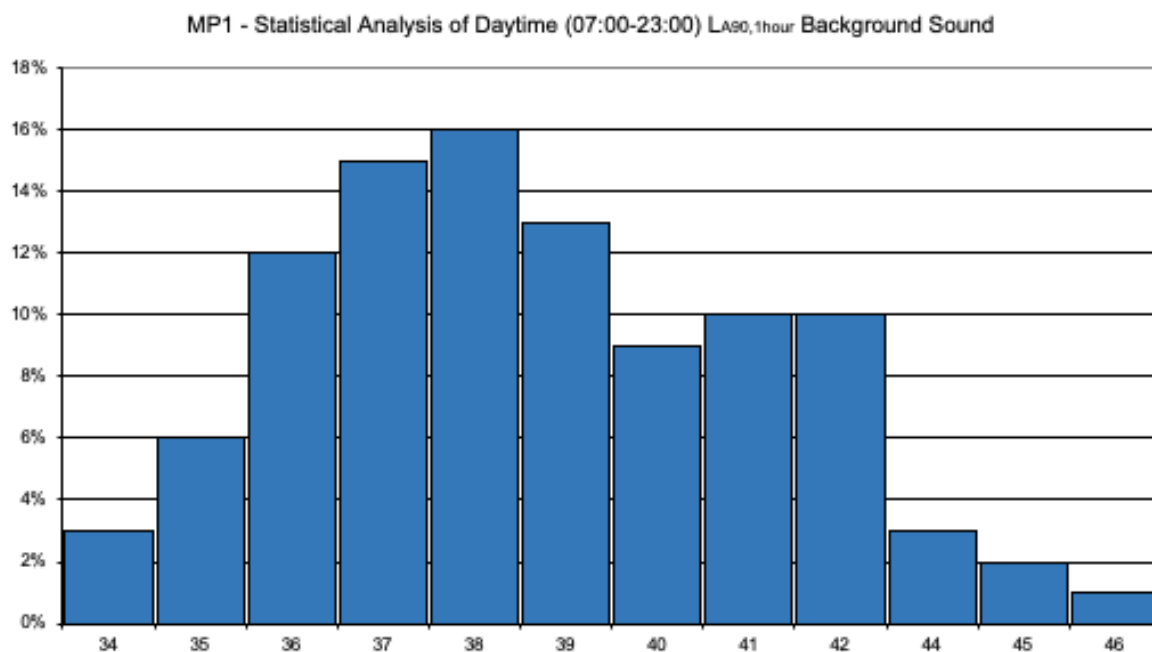


FIGURE 11: STATISTICAL ANALYSIS OF L_{A90} BACKGROUND – NIGHT-TIME – MP1

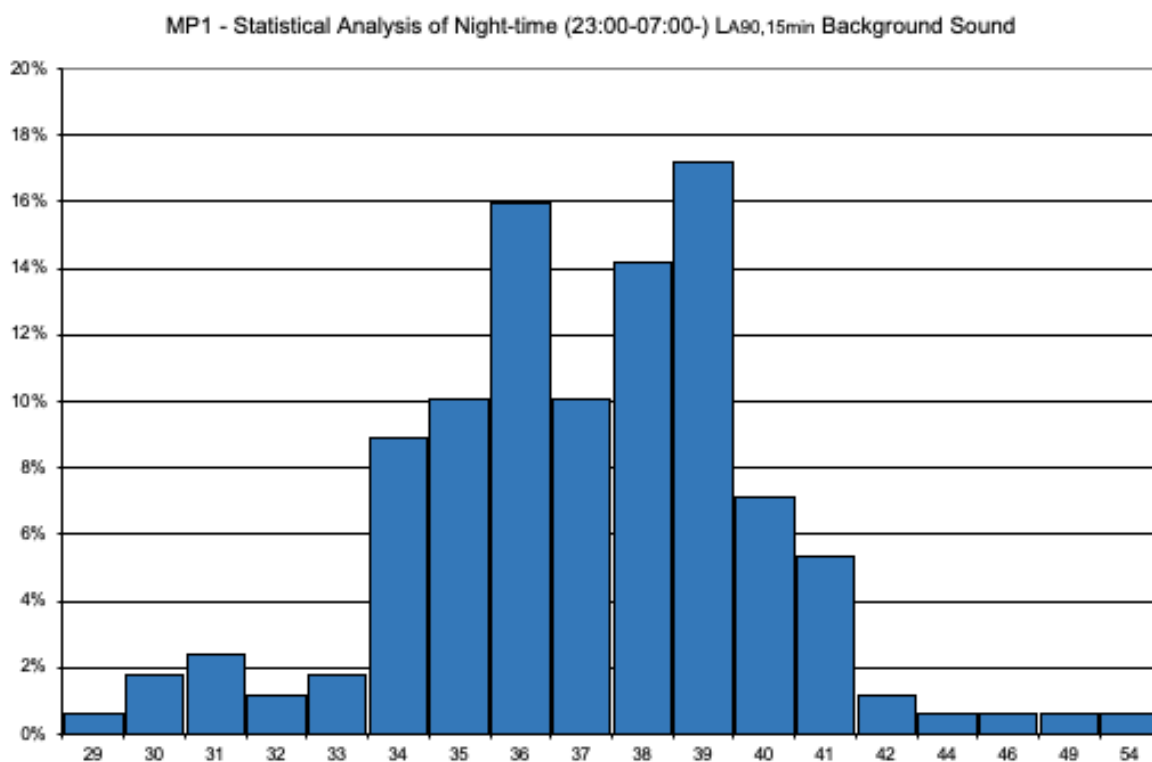


FIGURE 12: STATISTICAL ANALYSIS OF L_{A90} BACKGROUND – DAYTIME – MP2


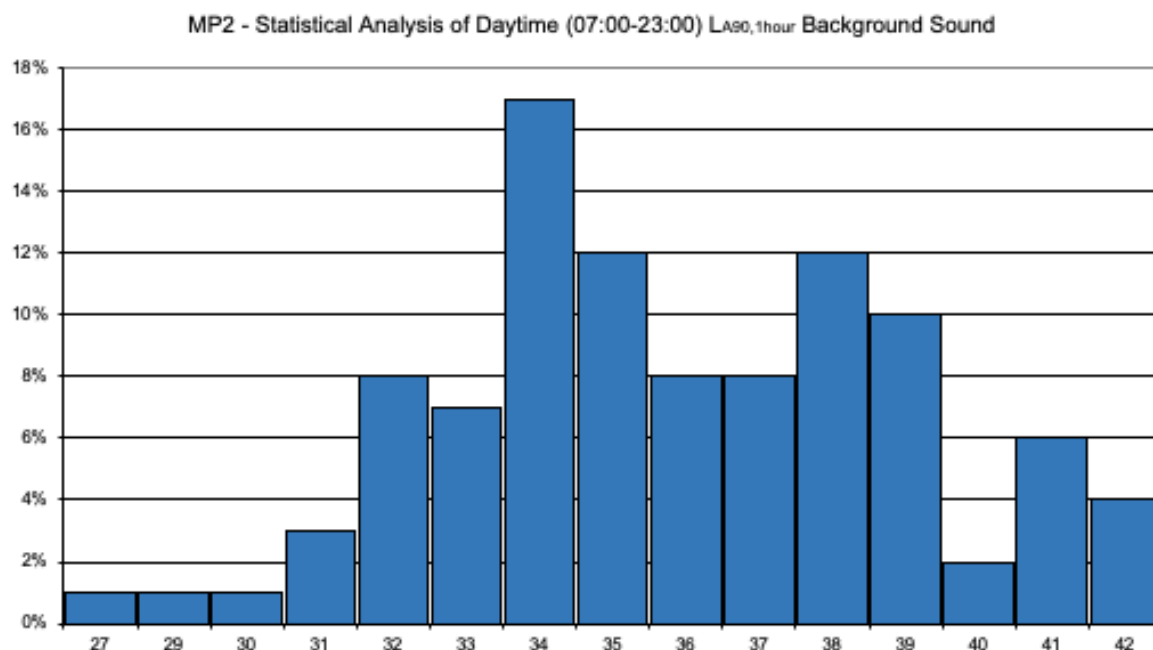


FIGURE 13: STATISTICAL ANALYSIS OF L_{A90} BACKGROUND – NIGHT-TIME – MP12

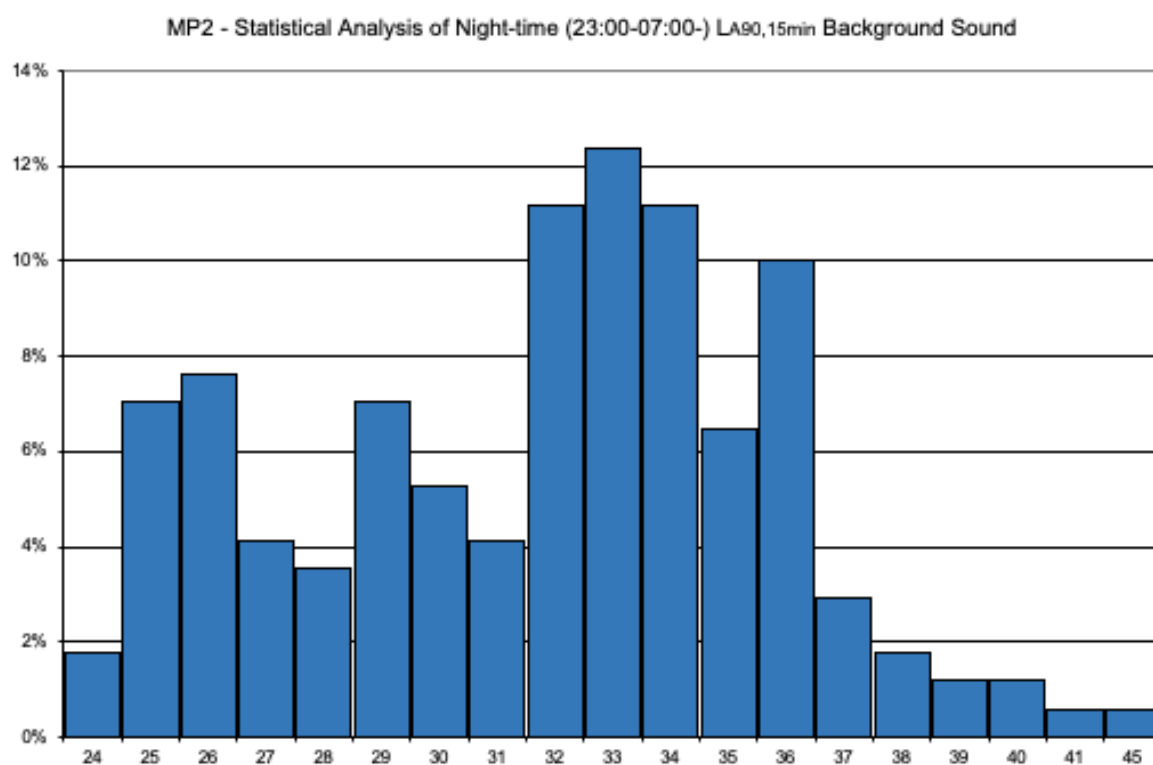

inacoustic | **bristol**

Caswell Park, Caswell Lane, Clapton-in-Gordano, Bristol, BS20 7RT

0117 325 3949 | www.inacoustic.co.uk | bristol@inacoustic.co.uk

inacoustic is a trading name of Inacoustic Limited, registered in the UK 10873933